




WWW System Planning
225 North Pearl Street
Jacksonville, FL 32202
June 2025

CHILLED WATER CUSTOMERS

DOWNTOWN PLANT
Contract Load*: 6,574 tons
Plant Capacity: 7,200 tons
Plant is expandable to 14,400 tons

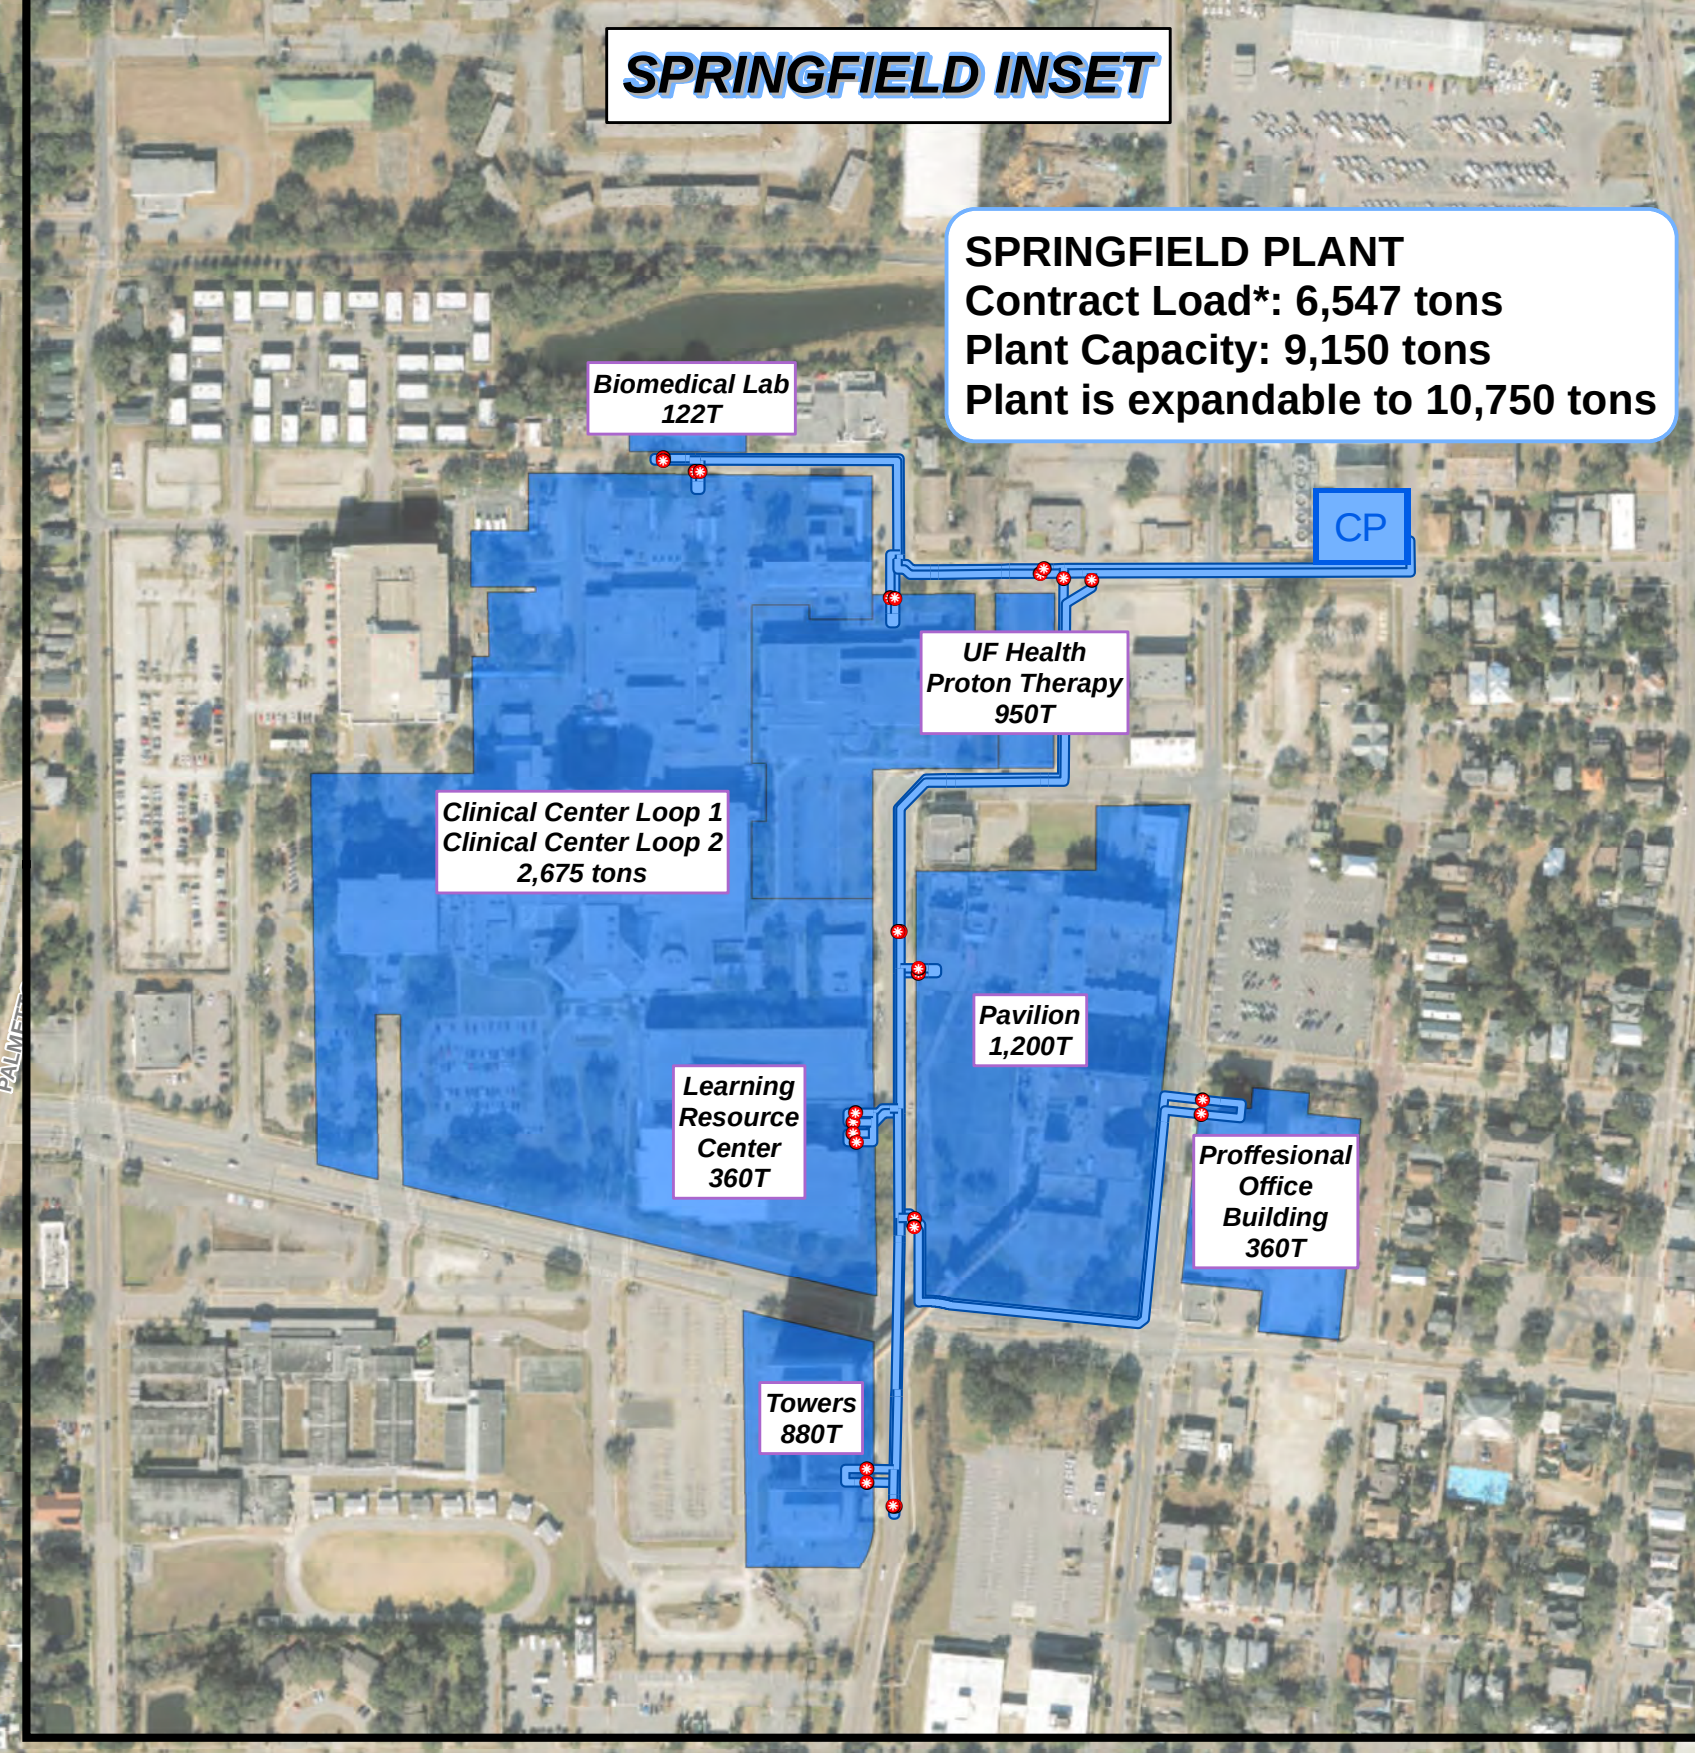

HOGANS CREEK PLANT
Contract Load*: 5,230 tons
Plant Capacity: 3,400 tons
Plant is expandable to 12,000 tons


Hogans Creek Cooling Tower Upgrade

Segment B
1,400 LF of 20" Mains
(Supply & Return)

Legend

- CP JEA Chilled Plant
- JEA Chilled Valve
- JEA Chilled Main
- Proposed Chilled Main
- Existing Customer
- Proposed Customer

*Contract Loads are peak loads
and may or may not be coincidental

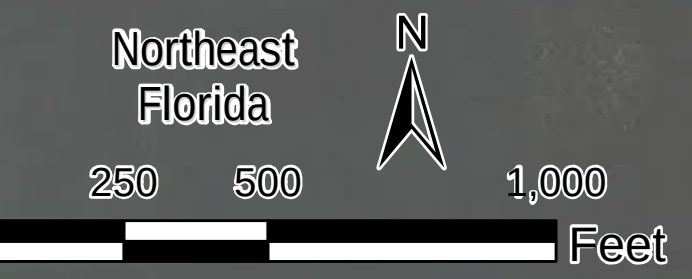

Disclaimer of Liability: Accuracy of the data contained on this map is contingent upon the source information as compiled by various agencies both internal and external to JEA. Maps are provided "as is" without warranty or any representation of accuracy, timeliness, completeness, or financial commitment. JEA assumes no legal responsibility for the information contained on this map.